



GLENDALE HEIGHTS
 500 Windy Point Drive
 Glendale Heights, IL 60139
 Phone: 630-534-4900
 Fax: 630-534-4742

CHICAGO
 2740 W. Grand Avenue
 Chicago, IL 60612
 Phone: 773-772-7400
 Fax: 773-772-1077

CRESTWOOD
 4621 W. 136st
 Crestwood, IL 60445
 Phone: 708-239-6200
 Fax: 708-631-3417

www.nucomfortsupplyinc.com

AIR CONDITIONING JOBSITE INFORMATION SHEET

1. Circle metering device used.
2. Circle Yes or No at drier locations.
3. Circle service Ports used.
4. Sat. Temp. is pressure converted to Temp.


Saturation Temp. <input type="text"/> # <input type="text"/>	Saturation Temp. <input type="text"/> # <input type="text"/>
Low PSIG	High PSIG

Formula for Super Heat

Vapor Line Temp. Minus Sat Temp. Equals Super Heat

Formula for Sub Cooling

Sat Temp. Minus Liquid Line Temp. Equals Sub Cooling

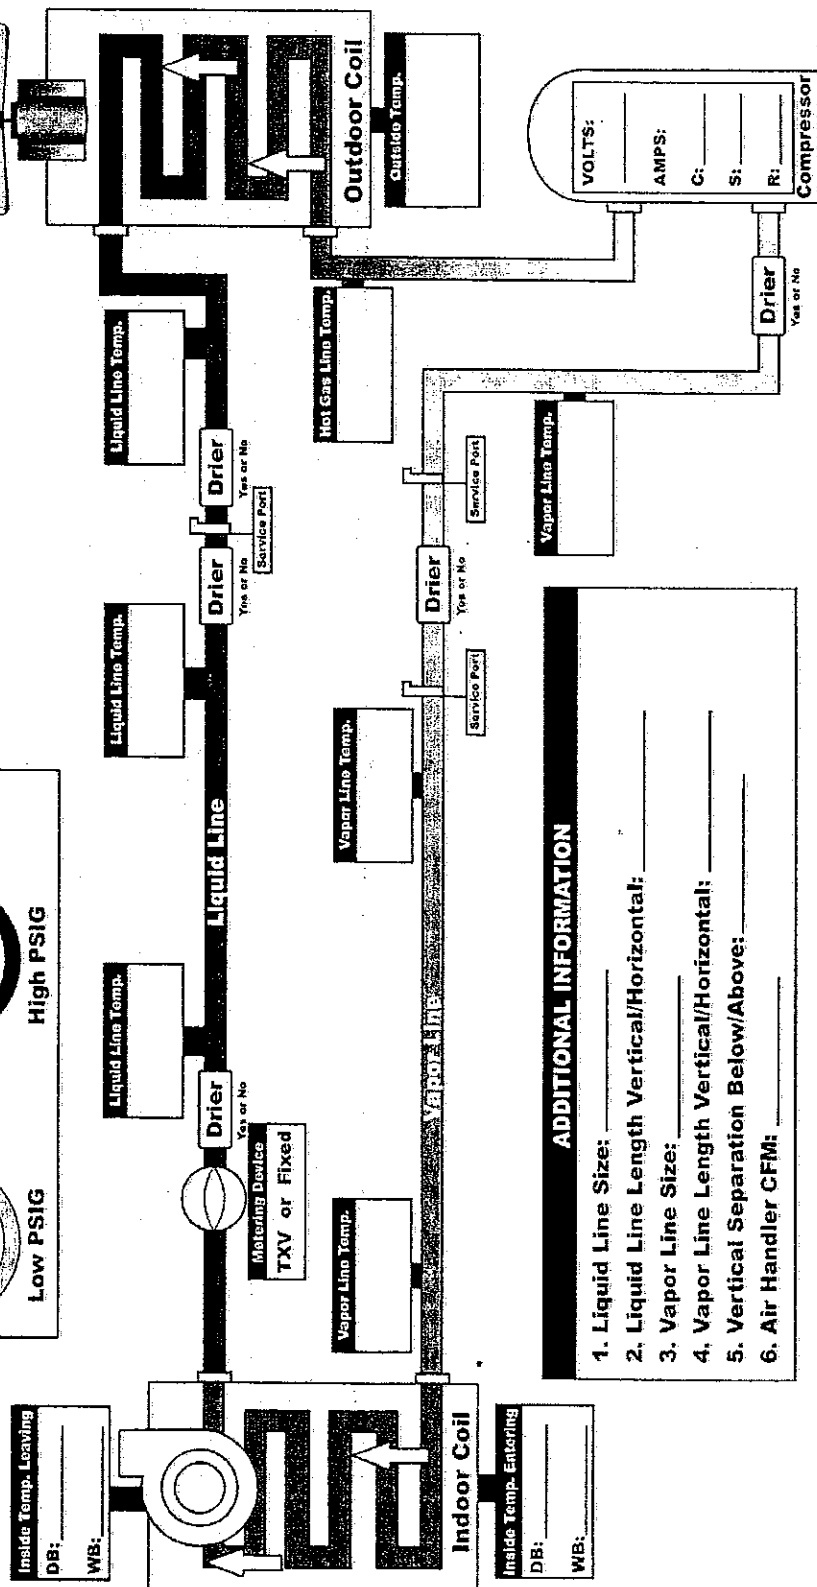

ADDITIONAL INFORMATION

1. Liquid Line Size:
2. Liquid Line Length Vertical/Horizontal:
3. Vapor Line Size:
4. Vapor Line Length Vertical/Horizontal:
5. Vertical Separation Below/Above:
6. Air Handler CFM:

Model # _____ Voltage _____ Locked Rotor (LRV) _____

Serial # _____ Static _____ Running _____

External Static Pressure ESP _____